


Mass Spectrum

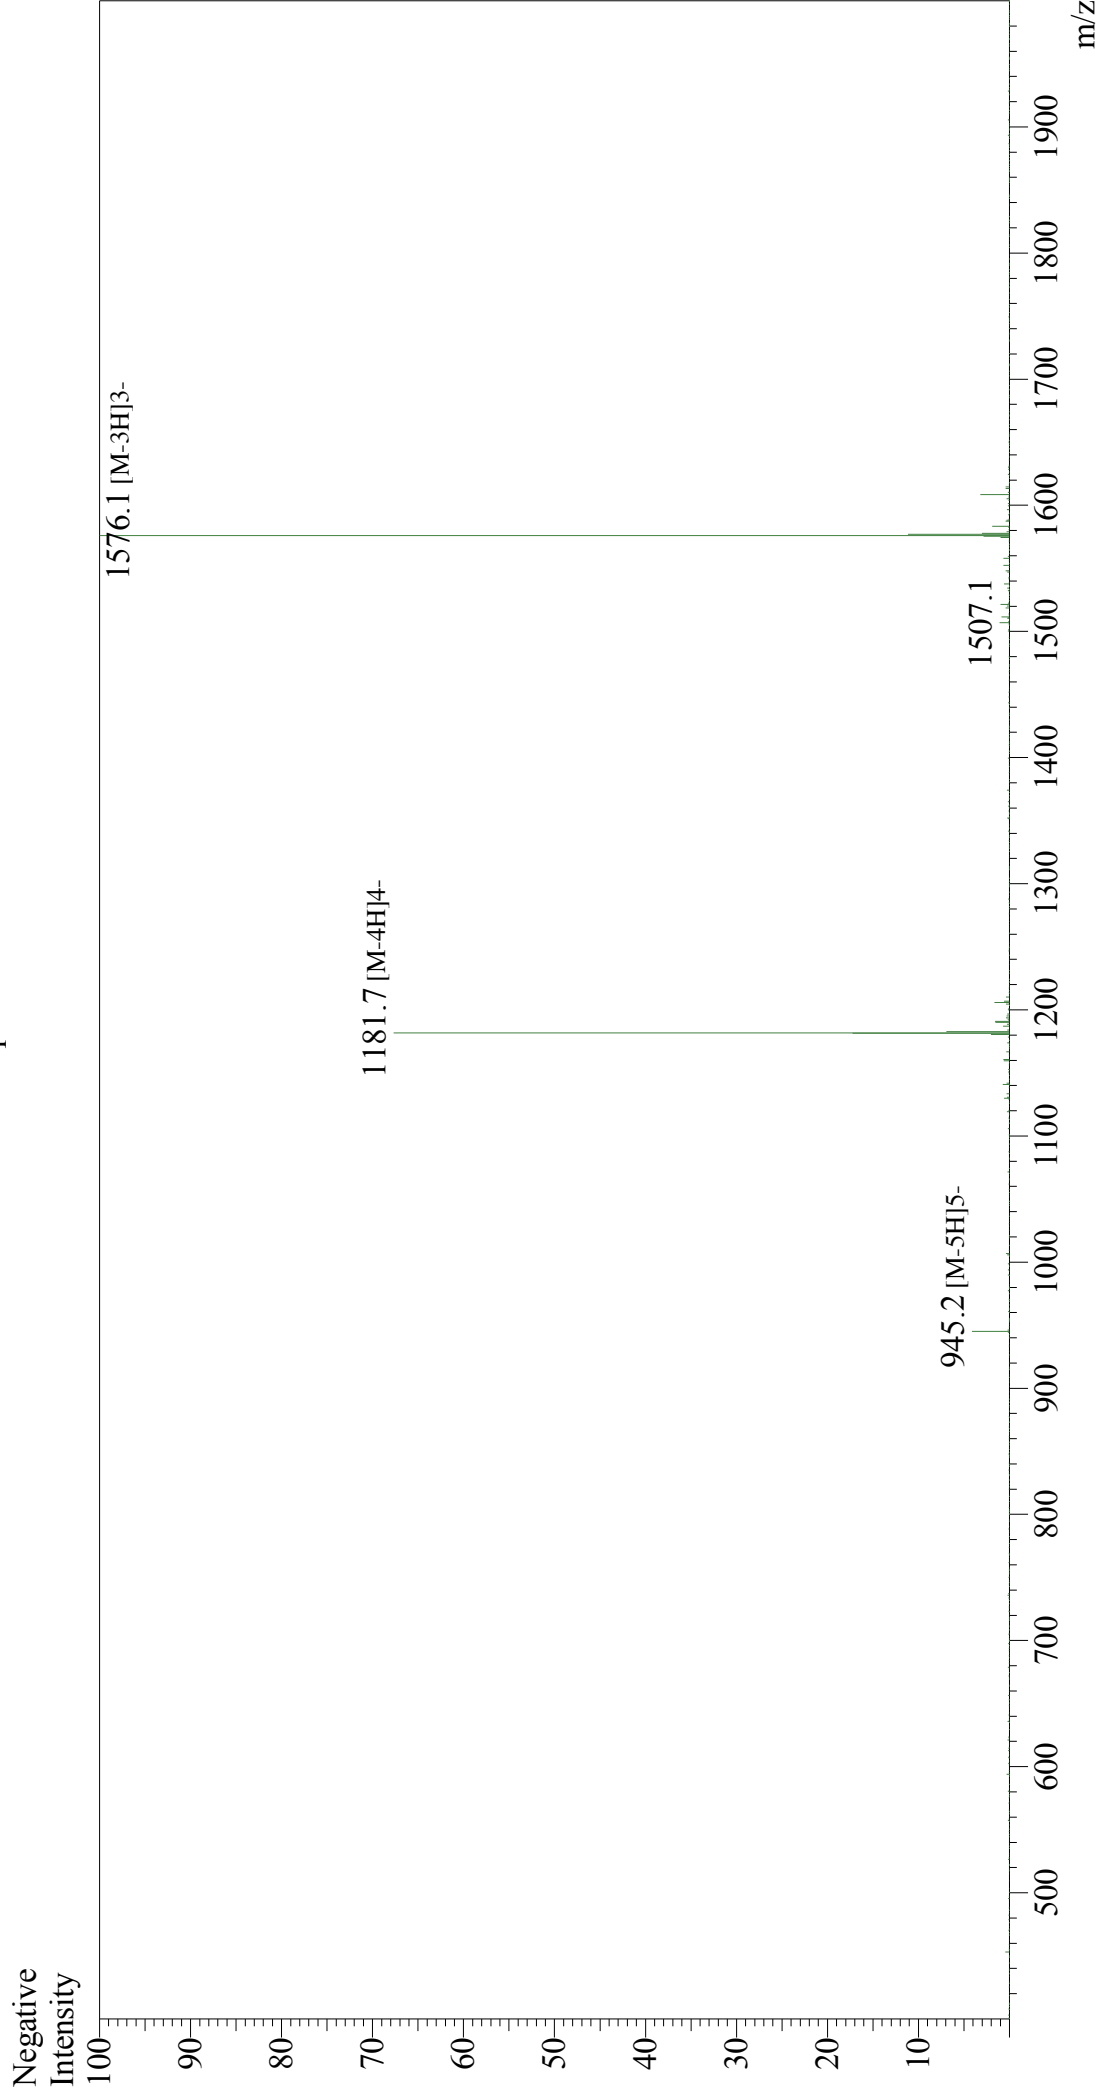

Sample Information

Month-Day Processed : 07/29/25
Time Processed : 13:48:07
Injection Volume : 0.3
Sample Name : Retatrutide (Triple Agonist Peptide)
Sample ID : U3398KSTG0-8
Theoretical MW : 4731.40
Observed MW : 4731.3

Interface : ESI
Nebulizing Gas Flow : 1.5 L/min
CDL Temp : 250
Block Temp : 200

Equipment : ZJ21010035
Interface Bias : -3.5 kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2 ml/min
B.conc : 50% H₂O / 50% MeOH